


I 1	I 2	I 3	Relais Alarme
98.8 A	88.1 A	98.5 A	Contact ouvert
V 1	V 2	V 3	Fréquence
226.3 V	228.7 V	227.6 V	50.1 Hz
Pa 1	Pa 2	Pa 3	Pa Tot.
17.7 kW	17.7 kW	18.2 kW	53.6 kW
Pv 1	Pv 2	Pv 3	Pv Tot.
10.0 KVAr	9.6 KVAr	9.7 KVAr	29.3 KVAr
Fp 1	Fp 2	Fp 3	Fp Glob.
0.86	0.87	0.87	0.88


Measurements

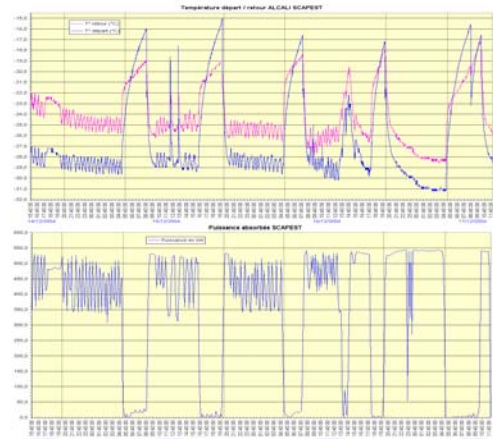

Energy audits


### COMPETENCES

- Air-conditioning service sector.
- Computer room.
- Treatments of environment.
- Laboratories.
- Clean room.
- Process.
- Formations.
- Regulations and standardizations.

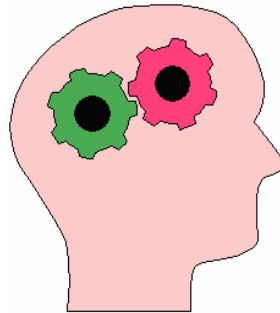

### MISSIONS

- Feasibility studies.
- Project studies.
- Follow-up of construction.
- Measurement series.
- Technical audits.
- Energy audits.
- Assistances.

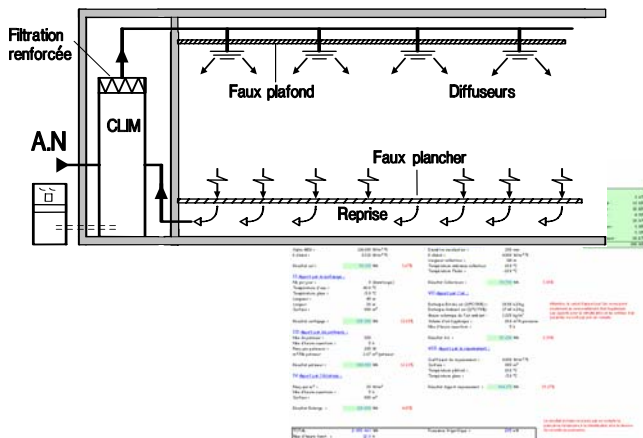

Designs



Follow-up of projects